

Evidence of Performance

Mechanical durability, Operating forces



Test Report
No. 12-002998-PR01
(PB-A01-03-en-01)

Client Arbor Ahsap Yapı Elemanları
Atatürk bulvarı Köstemir yolu
No:74 Silivri
Istanbul
Turkey

Basis
EN 14351-1:2006+A1:2010

Test standard/s:
EN 1191:2000-02
EN 12046-1:2003-11

Product Single side hung window

Designation System designation: 68S


Performance-relevant product details Material: Wood

Overall dimensions (WxH) 570 mm x 1,050 mm

Special features

Correspond/s to the national standard/s (e.g. DIN EN)

Representation

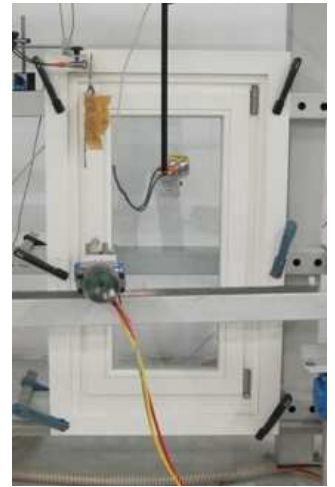

Results

Mechanical durability according to EN 12400:2002-10



Class 2

Operating forces according to EN 13115:2001-07



Class 2

Instructions for use

The results obtained can be used by the manufacturer as the basis for the manufacturer ITT test report summary. Observe the specifications set out by the applicable product standard.

Validity

The data and results refer solely to the tested and described specimen. Classification remains valid as long as the product and the above basis remain unchanged. The results can be extrapolated under the manufacturer's own liability subject to observance of the relevant specifications set out by the applicable product standard. This test/evaluation does not allow any statement to be made on any further characteristics regarding performance and quality of the construction presented; in particular the effects of weathering and ageing were not taken into account.

Notes on publication

The ift-Guidance Sheet "Advertising with ift test documents" applies. The cover sheet can be used as an abstract.

The report contains a total of 14 pages.

ift Rosenheim
29.01.2013

Robert Kolacny, Dipl.-Ing. (FH)
Deputy Head of Testing Department
Building Components

Rolf Schnitzler, Dipl.-Ing. (FH)
Operating Product Officer
Building Components